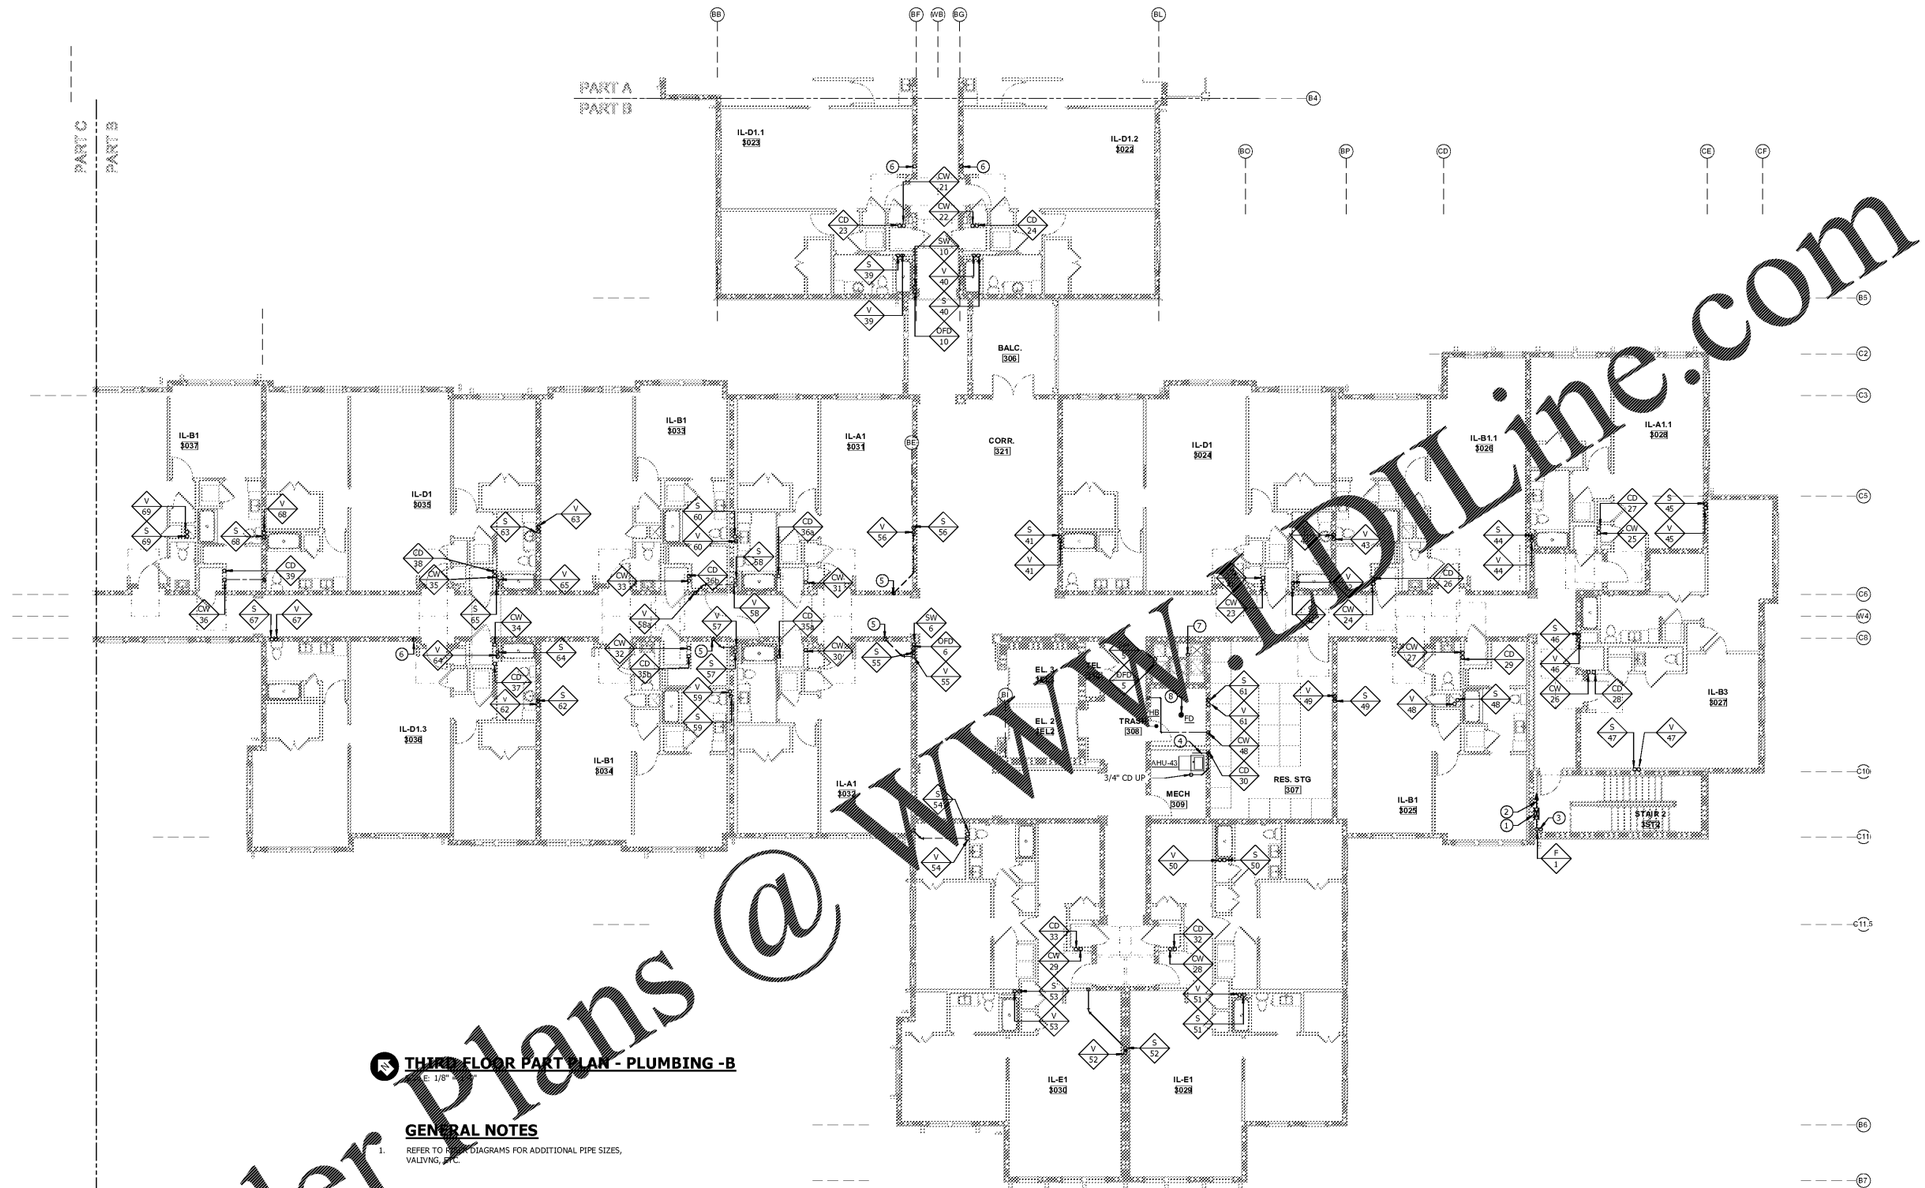

THIRD FLOOR PART PLAN - PLUMBING -B

SCALE: 1/8"

GENERAL NOTES

1. REFER TO RISER DIAGRAMS FOR ADDITIONAL PIPE SIZES, VALVING, ETC.

DRAWING NOTES:

1. ZONE CONTROL ASSEMBLY. REFER TO DETAIL - TYPICAL SPRINKLER ZONE VALVE ASSEMBLY ON SHEET P-502 FOR VALVING INFORMATION.
2. TO SPRINKLER SYSTEM ON THIS FLOOR.
3. SPRINKLER DRAIN RISER.
4. ROUTE CONDENSATE LINE FROM AIR HANDLING UNIT TO CONDENSATE RISER.
5. 2" VENT DOWN TO SERVE RESIDENTIAL UNIT ON FLOOR BELOW.
6. 2" VENT UP AND DOWN TO SERVE RESIDENTIAL UNIT ON FLOOR BELOW.
7. 3/4" NATURAL GAS UP AND DOWN.
8. ROUTE SANITARY AND VENT TO FLOOR DRAIN, FD, FROM SANITARY RISER #61 AND VENT RISER #61 . REFER TO RISER DIAGRAM FOR MORE INFORMATION.



Key Plan - Part B

SCALE: 1/8" = 1'-0"

8 0 8 16

Order Plans @ WWW.LDLine.com

bct

architect | designer
BCT ARCHITECTS
100 North Charles Street, 18th floor
Baltimore, MD 21201
410.837.2727
www.bctarchitects.com

structural engineer
CARROL ENGINEERING, INC.
215 Shilling Circle, Suite 102
Hunt Valley, MD 21031
t 410.785.7423
www.carrollengineering.com

mep engineer
KIBART, INC.
901 Dulaney Valley Road, Suite 301
Towson, MD 21204
t 410.494.1111
www.kibart.com

civil engineer
HLA, Inc.
29A Leinback Drive
Charleston, SC 29407
t 843.763.1166
www.hlainc.com

landscape architect
LAND DESIGN, LLC
200 South Peyton Street
Alexandria, VA 22314
t 703.549.7784
www.LandDesign.com

interior designer
AUMEN ASNER
100 North Charles Street, Suite 910
Baltimore, MD 21201
t 410.837.2767
www.aumenasner.com

code + life safety consultant
KOFFEL ASSOCIATES, INC.
8815 Centre Park Dr., Suite 200
Columbia, MD 21045
t. 410.794.1610
www.koffel.com

project
DHEC Project Number #: 637063

BEES FERRY SENIOR LIVING

3097 Bees Ferry Road
Charleston, South Carolina 29414

client | owner
3097 BEES FERRY ROAD, LLC
3535 Colonel Vanderhost Circle
Mount Pleasant, SC 29466
t 843.296.3985

seal | signature



10/18/2019

revisions

No.	Date	Title

sheet title

THIRD FLOOR PART PLAN - PLUMBING - B

issue date 10/18/2019

sheet number

P-210

© 2019 BCT Architects LLC 17-220