GENERAL NOTES:

1. UNLESS NOTED OTHERWISE, LIGHTING (NON-SHADED) IN THE FOLLOWING SPACES LABELED: LOUNGES, RECEPTION, MARKET, MAIL, VESTIBULE, PUB, GRILL, LIVING ROOMS, MULTIPURPOSE ROOMS, LIBRARY, CAFE, AND GREAT ROOM SHALL BE CONTROLLED VIA A LOW VOLTAGE LIGHTING CONTROL PANEL SYSTEM. THE CONTROL PANEL SHALL TURN ON LIGHTS AT FULL BRIGHTNESS (7:00 AM) AND OFF (11:00 PM). THE OCCUPANCY SENSORS IN EACH OF THESE SPACES SHALL ONLY BE OPERABLE DURING THE OFF HOURS.
2. UNLESS NOTED OTHERWISE, LIGHTING (NON-SHADED) IN CORRIDORS SHALL BE CONTROLLED VIA A LOW VOLTAGE LIGHTING CONTROL PANEL SYSTEM. THE CONTROL PANEL SHALL TURN ON ALL CORRIDOR LIGHTING(NON-SHADED) TO FULL BRIGHTNESS (7:00 AM - 11:00 PM) AND DIM TO 50% BETWEEN THE HOURS OF 11:01 PM TO 6:59 AM. THE OCCUPANCY SENSORS IN CORRIDORS SHALL ONLY BE OPERABLE DURING 11:01 PM TO 6:59 AM. HOWEVER IF DURING THE TIME THE LIGHTS ARE DIMMED AND OCCUPANCY IS SENSED, THE OCCUPANCY SENSOR SHALL RAISE LIGHTS TO 100 %. OCCUPANCY SENSORS IN THESE SPACES ARE ONLY TO BE ACTIVATED DURING THE DESIGNATED DIMMED TIME FRAME.
3. PROVIDE QUANTITY OF BRIDGE AND ROOM CONTROLLERS IN EACH SPACE AS NEEDED.
4. PROVIDE ALL WIRING REQUIRED FOR SWITCH LEGS AS NECESSARY.
5. REFER TO LIGHT FIXTURE SCHEDULE FOR DIMMING TYPE (ELV OR 0-10V).
6. CORRIDOR LIGHTING CONTROLS REQUIRE 0-10V DIMMING (TYPE A FIXTURES) AND ELV DIMMING (ALL OTHER FIXTURES).

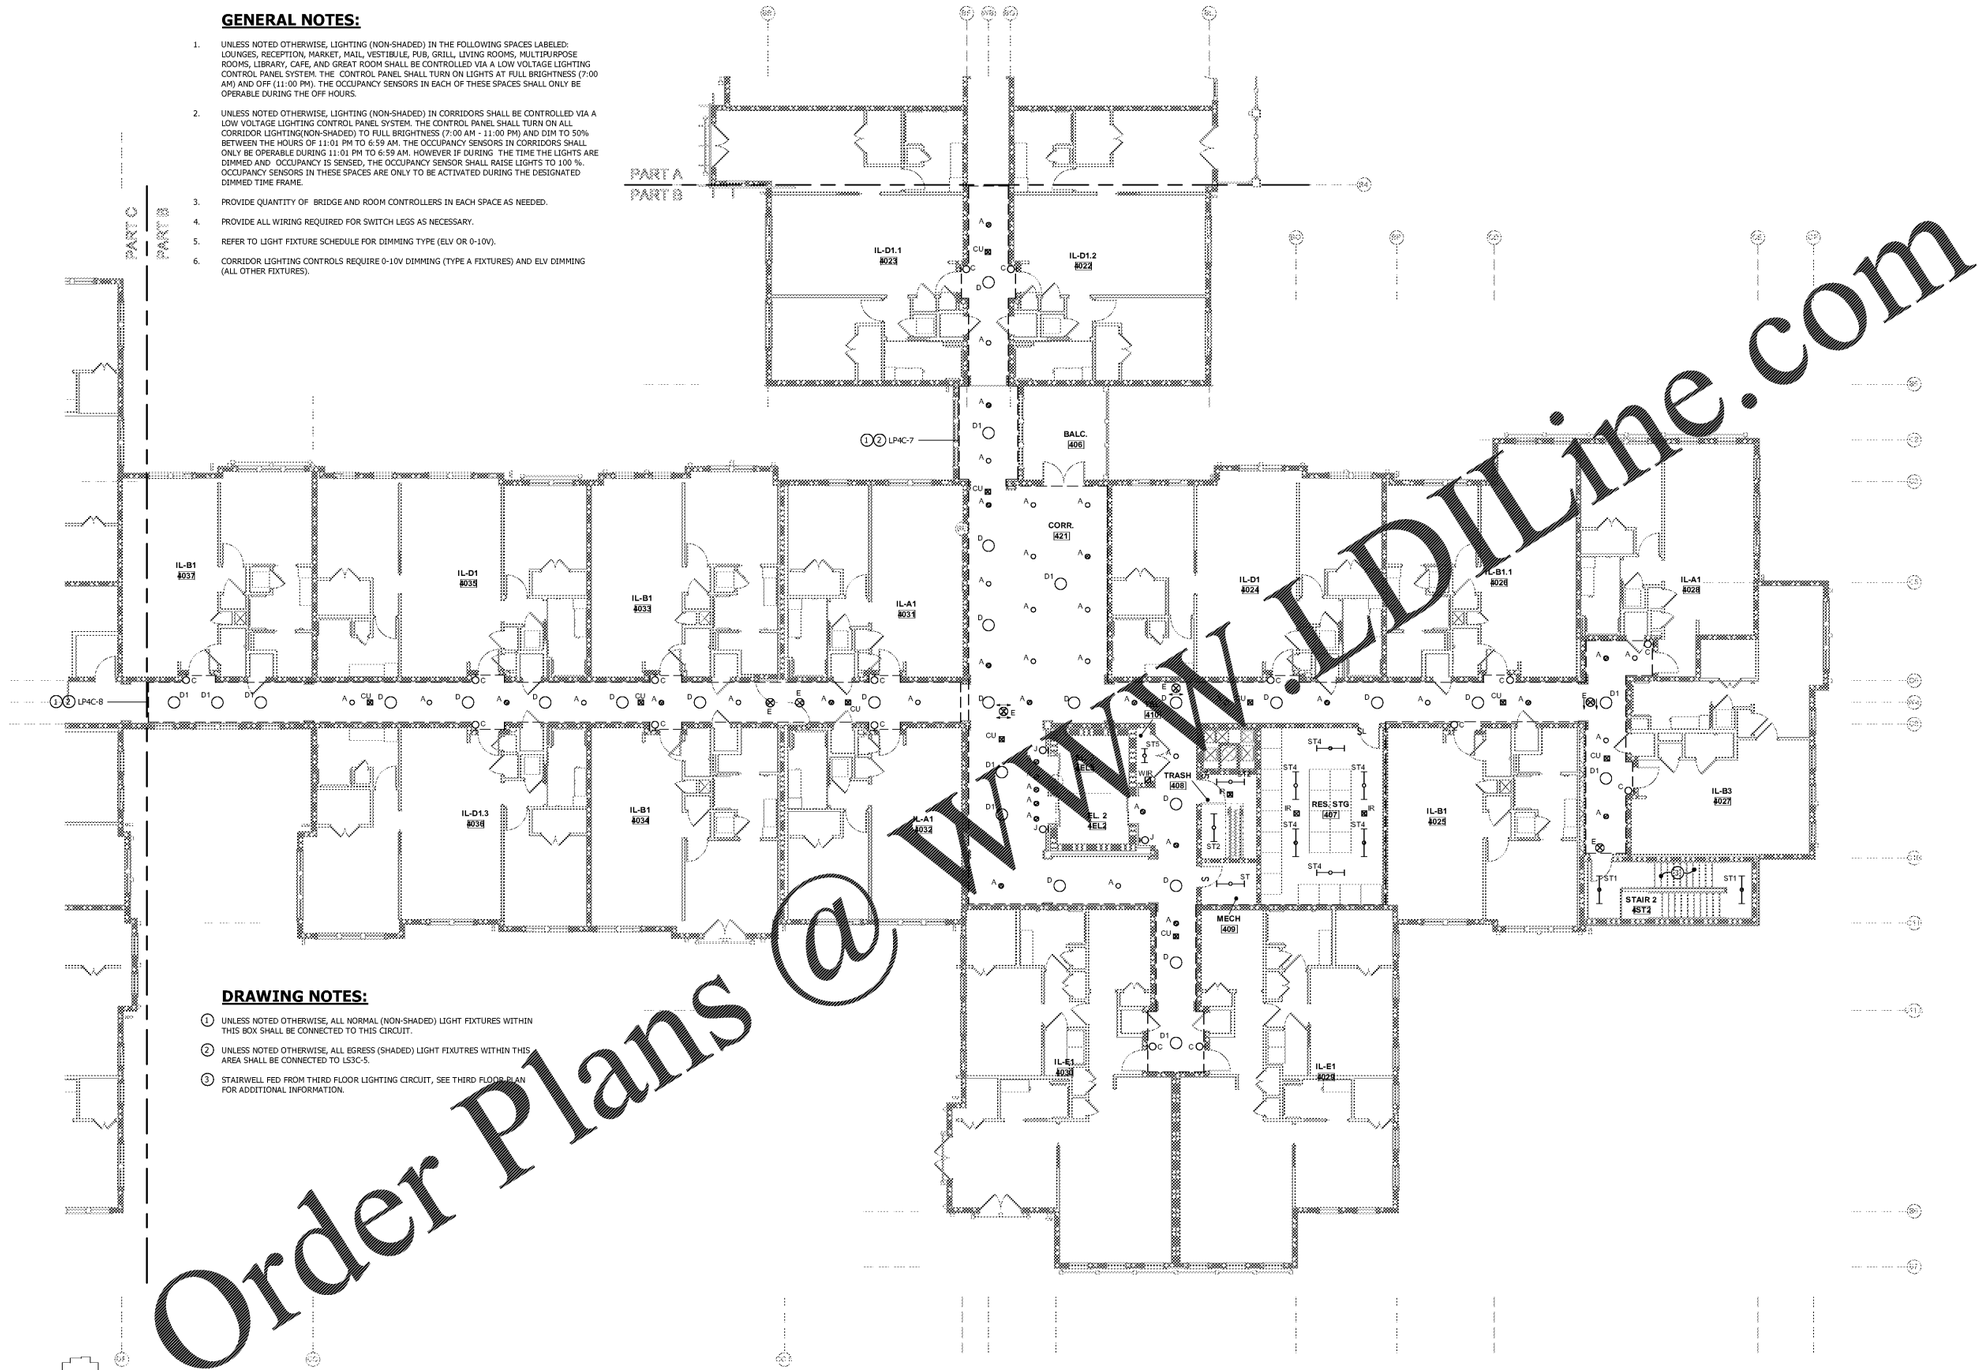

DRAWING NOTES:

1. UNLESS NOTED OTHERWISE, ALL NORMAL (NON-SHADED) LIGHT FIXTURES WITHIN THIS BOX SHALL BE CONNECTED TO THIS CIRCUIT.
2. UNLESS NOTED OTHERWISE, ALL EGRESS (SHADED) LIGHT FIXUTRES WITHIN THIS AREA SHALL BE CONNECTED TO LS3C-5.
3. STAIRWELL FED FROM THIRD FLOOR LIGHTING CIRCUIT, SEE THIRD FLOOR PLAN FOR ADDITIONAL INFORMATION.

FOURTH FLOOR LIGHTING - B
SCALE: 1/8" = 1'-0"



Key Plan - Part B

SCALE: 1/8" = 1'-0"
8 0 8 16

Order Plans @ WWW.LDILine.com

bct

architect | designer
BCT ARCHITECTS
100 North Charles Street, 18th floor
Baltimore, MD 21201
410.837.2727
www.bctarchitects.com

structural engineer
CARROL ENGINEERING, INC.
215 Shilling Circle, Suite 102
Hunt Valley, MD 21031
t 410.785.7423
www.carrollengineering.com

mep engineer
KIBART, INC.
901 Dulaney Valley Road, Suite 301
Towson, MD 21204
t 410.494.1111
www.kibart.com

civil engineer
HLA, Inc.
29A Leinback Drive
Charleston, SC 29407
t 843.763.1166
www.hlainc.com

landscape architect
LAND DESIGN, LLC
200 South Peyton Street
Alexandria, VA 22314
t 703.549.7784
www.LandDesign.com

interior designer
AUMEN ASNER
100 North Charles Street, Suite 910
Baltimore, MD 21201
t 410.837.2767
www.aumenasner.com

code + life safety consultant
KOFFEL ASSOCIATES, INC.
8815 Centre Park Dr., Suite 200
Columbia, MD 21045
t. 410.794.1610
www.koffel.com

project
DHEC Project Number #: 637063

BEES FERRY SENIOR LIVING

3097 Bees Ferry Road
Charleston, South Carolina 29414

client | owner
3097 BEES FERRY ROAD, LLC
3535 Colonel Vanderhost Circle
Mount Pleasant, SC 29466
t 843.296.3985

seal | signature

10/18/2019

revisions

No.	Date	Title

sheet title

PARTIAL LIGHTING PLAN - LEVEL 4 - PART B

issue date 10/18/2019

sheet number

E-141

© 2019 BCT Architects LLC 17-220